


NOTES:

1. THE LENGTH OF THE RAMP SHALL BE SUCH THAT THE SLOPE DOES NOT EXCEED 12:1.
2. THE NORMAL GUTTER SHALL BE MAINTAINED THROUGH THE AREA OF THE RAMP.
3. THE MINIMUM THICKNESS FOR THE RAMP, WALK, & LANDING SHALL BE 4".
4. DETECTABLE WARNING DEVICES SHALL BE PLACED AT ALL LOCATIONS WHERE RAMPS CROSS A CURB.

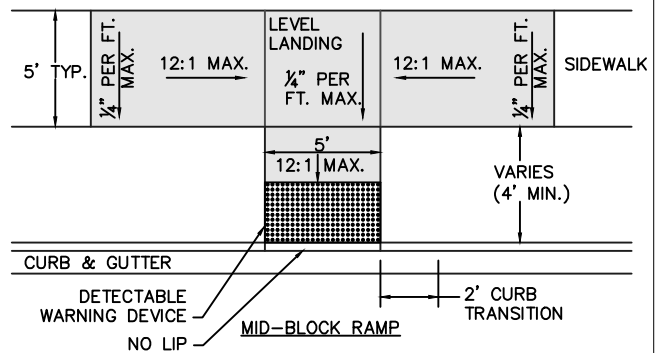

HANDICAP RAMP DETAILS

NOT TO SCALE

**STANDARD DETAILS FOR
STREET & DRAINAGE
CONSTRUCTION**

**SECTION B
TYPICAL STREET, DRIVEWAY &
SIDEWALK DETAILS**

DATE: NOVEMBER 2016

DESIGNED BY: KPP

DRAWN BY: KPP

CHECKED BY: KPP

APPROVED BY: BNB

FILE NO. SD-B-2



SPRINGDALE
WE'RE MAKING IT HAPPEN